# **EMPR**



### Electronic motor protection relays

**EMPR** is digital motor protection relay where the MCU (Microprocessor Control Unit) is built-in and features excellent reliability by achieving real-time data processing and high precision.





# G

Features	G-6
Ordering	G-9
Specification	G-1
Characteristics	G-1
Setting method	G-2
Dimensions	G-3
Wiring method	
Accessories	G-4
Direct mounting FMPR new/old comparative table	G-4



**EMPR** replacing thermal overload relay is electronic motor protect relay which is used to protect the low voltage motor and also called as Electronic Overcurrent Relay or an Electronic Overload Relay.

As a digital motor protection relay with MCU EMPR is highly reliable by realization of real-time data processing and, retention confidentiality and also can secure motor safely with various functions such as phase loss, phase reverse, unbalanced, stall, lock, ground fault, short circuit protection depending on the model.

Compact and stylish appearance can be combined with the magnetic contactor and various installation methods make easy design features and manufacture motor control panel.

Especially, EMPR is EMC tested and approved to operate safely without any malfunction caused by electromagnetic wave and surge. Most of the models have received CE Mark and UL certification.







**General Motor Protection Relay** 

#### **GMP Series**

- Various connection & mount
- · Inverse or definite time mode
- · Ground fault type
- · Display the causes of the falut by LED



**Digital Motor Protection Relay** 

#### **DMP Series**

- · Ampere meter, Load rate and the causes of fault Display
- · Standard, Ground fault and short circuit protection type
- Select the Inverse or definite time modes
- · Unit or Extension in one body by cable option
- Option function type (DMP-a)



Intelligent Motor Protection Relay

#### **IMP Series**

- Wide current setting range (0.125~100A)
- Communication support type
- · Zero current and residual current sensing
- · Save the fault events and operating time setup
- · Select the Inverse, thermal inverse or definite time modes
- · Unit or Extension in one body by option cable




#### **Features**

#### **GMP Series**

• Combination with Metasol contactors for compact motor starters

EMPR model	Contactor model
GMP22-2P/3P/3PR	MC-9b, MC-12b, MC-18b, MC-22b
GMP40-2P/3P/3PR	MC-32a, MC-40a

- Broad range of current setting
- Inverse time or definite time characteristics
- Simple operation and trip cause indication via LED
- Various Connection

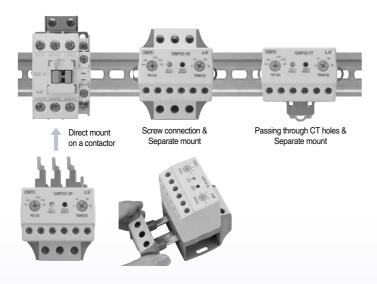



Certification of CE, UL, CCC and S mark









#### • Various protection functions

Types (GMP-□)	2P, 2T, 2S	3P, 3T, 3S	3PR, 3TR, 3SR	3TN, 3TZ	3TNR, 3TZR		
Number of sensors	2CT	3CT					
Overcurrent							
Phase failure							
Lock/Stall							
Phase unbalance							
Reverse phase							
Ground fault							

- Large current can be applied through additional current transformers
- MCU (Microprocessor Control Unit) built-in
- excellent reliability by achieving real-time data processing and high precision.
- Store of the last failure cause
- can be checked by Test/Reset button 2 times.
- Products for ground fault protection
- detecting of zero phase currents (ZCT used: GMP60-3TZ)
- detecting of residual currents (ZCT unused: GMP60-3TN)



#### **Features**

#### **DMP Series**

- Digital measuring and displaying
  - Display digital ampere-meter
  - Save the causes of the fault and the value
  - Display motor load rate by graph







#### • Convenient structure

- Install the Unit / Extension type in one body
   The display part may be separated from the body
   You can check the values and the causes of the fault without opening the distribution panel door
- removable terminal block






#### • Various protection functions

Protection	DMP⊡-S/Sa	DMP∏-SZ/SZa	DMP∐-SI	DMP <u></u> -T/Ta	DMP <u></u> -TZ/TZa	DMP∐-TI
Wiring		Screw type			Tunnel type	
Over current						
Under current						
Stall						
Lock						
Phase failure						
Reverse phase						
Phase unbalance						
Ground fault						
Short circuit						

#### • Trip curve selectable (Inverse/Definite)



- Applicable to inverter control circuit
- LS DMPR has high performance under the harmonic noise and can be used in the Inverter control circuit ( $20\sim200$ Hz)
- Optional functions (DMP-a type)
  - Storing up the last fault cause
  - Storing up motor operation hours

### **Features**

#### **IMP Series**

The EMPR IMP series are optimal solutions for protecting and monitoring motors in complex industrial fields and provide high safety and productivity.





### Wide Current Setting Range: 0.125~100A for One Model

With the slide S/W, the current setting range can be decided 0.5~10A or 5~100A. According to the CT penetration number, even 0.125A current can be protected. (Wire penetration hole).



#### Communication support type

RS-485 MODBUS communication with various systems. The model with analogue signals (4~20mA) is compatible with transducer systems.



#### Thermal Inverse Time, Inverse Time and Definite Time Modes

According to user's needs, the motor can be protected in the inverse time mode or definite time mode.



### Wide Ground Fault Sensitivity 30mA~25A

zero current sensing by zero sequence CT. zero current sensing by Residual circuit.



#### **Date and Total Operating Time Setup**

When a fault occurs, its date and time are stored for easy checkup. When the total operation time is over, it is displayed for changing motor bearings or supplying oil.



#### Quick Setup

All settings can be decided quickly on the display



### Total Digital Motor Protection Relay with the MCU (Microprocessor Control Unit)

Real-time processing and high precision



#### One-Body Type and Separate Body Type

The display can be attached to the panel front so that current, operation time and settings can be checked without fetching the unit. With the display separated, the motor can be protected.



#### **Applicable to Inverter Circuits**

Thanks to its good high harmonic noise characteristics, it can be applied to the of inverter control circuits. The available frequency range is 20~200Hz. When the relative harmonic factor is over 30%, a harmonic filter should be installed (However, the ground fault function should be off).



#### **Various Reset Functions**

Manual, automatic and electric reset functions are provided for customer convenience.



#### **Password**

Settings are protected with a password.



#### Storage of Fault Events

Up to five fault events can be stored for easy fault history management.




#### 3-Phase Digital Ampere-Meter


3-phase current is displayed every two seconds for motor monitoring.

### **Ordering**

#### **GMP Series**

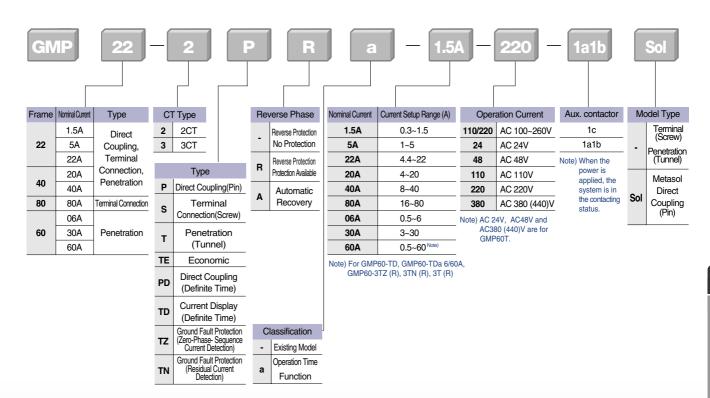


#### **DMP Series**

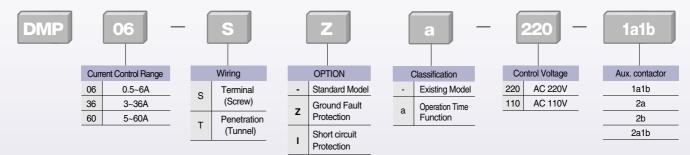

Note) 1. Even the same model has different contact specifications.
2. When the power is applied, the system is in the contacting status.

#### **IMP Series**

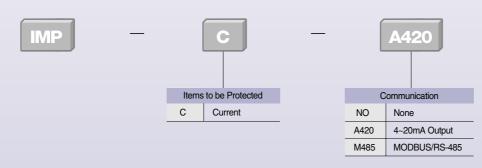

### Specification

### **GMP Series**

Ra	tings							
M	lodel	GMP22-2P/PD (1c)	GMP22- 2P(1a1b)	GMP22- 3P/3PR	GMP22-2S	GMP22- 3S/3SR	GMP22-2T	GMP22- 3T/3TR
Туре		Pir	n type		Scre	w type	Tunn	el type
No. of CT		2CT	2CT	3CT	2CT	3CT	2CT	3CT
Protection	Overcurrent	•	•	•	•	•	•	•
	Phase failure Note1)	•	•	•	•	•	•	•
	Lock/Stall	•	•	•	•	•	•	•
	Phase unbalance		_	•	_	•	_	•
	Reverse phase	_	_	● (3PR)	_	● (3SR)	_	● (3TR)
Current setting rai	nge (A)	0.3~1.5, 1~5, 4.4~22						
Operating time ch	aracteristics	Inverse time (GMP22-2PD: I	Definite time)					
Time setting	Inverse time	0~30 sec						
(sec)	Definite D-time	0.2~60 sec for GMP22-2PD						
	O-time	5sec (Fixed) for GMP22-2PE	)					
	Reset-time	Manual reset						
Tolerance	Current	±5%						
	Time	$\pm$ 5%(or $\pm$ 0.5sec)						
Control power	Voltage	AC 110V/220V(±10%)	AC 100~260	V				
	Frequency	50/60Hz						
Aux. contact	Contact Note 3)	1SPDT (1c)	2SPST (1a1	b)				
	Ratings	5A/250VAC Resistive load	3A/250VAC	Resistive load				
	Operate	(95	(95 ∤⊦ 96 Cl	ose) (	97 - ∤ 98 Open)			
Insulation resistar	nce	Min 100™	at 500Vdc					
Surge endurance	(IEC 61000-4-5)	5kV Apply the standard way	re					
Fast transient burs	st (IEC 61000-4-4)	2kV						
Environment	Operation	<b>-25~70</b> °C						
Temperature	Storage	<b>-30~80</b> °C						
	Relative humidity	30~90%RH(No freezing)						
Trip indicator		Red LED	Red/Green L	_ED	Red LED	Red/Green LED	Red LED	Red/Green LED
Dimension (mm)	W×H×D	44×71×78	53×78×87	.5	53×68×87.		53×38×87.	5
Mounting type		Direct mount onto a Metasol	MC (MC-9b-22b	)	Separate mo	unt (Screw or Di	n-rail) Note2)	
Certification		UL, cUL, CE						

Note) 1. When it is 2CT modle, only two-phase protection is available 2. The bracket for Din-rail mount is optional 3. When power applied Aux. contact operate

### Specification

### **GMP Series**

Rat	ings	8					10 10 M		
Me	odel	GMP40- 2P/PD/PA	GMP40- 3P/3PR	GMP40-2S	GMP40- 3S/3SR	GMP40-2T	GMP40- 3T/3TR	GMP80- 2S/SA	GMP80- 3S/3SR
Туре		Pin	type *	Screv	v type	Tunne	l type	Screv	v type
No. of CT		2CT	3CT	2CT	3CT	2CT	3CT	2CT	3CT
Protection	Overcurrent	•	•	•	•	•	•	•	•
	Phase failure Note1)	•	•	•	•	•	•	•	•
	Lock/Stall	•	•	•	•	•	•	•	•
	Phase unbalance	_	•	_	•	_	•	_	•
	Reverse phase	_	● (3PR)	_	● (3SR)	_	● (3TR)	_	● (3SR)
Current setting ran		4~20, 8~40						16~80	
Operating time cha			characteristics						
Time setting	Inverse time	0~30 sec							
(sec)	Definite D-time	0.2~60 sec (0							
	O-time		(GMP40-2PD)						
	Reset time		(Auto Reset type	e : GMP∐-A)					
Tolerance	Current	±5%							
	Time	±5% (or±0.							
Control power	Voltage	AC 100~260\							
Aux. contact	Contact Note2)	2SPST (1a1b	*						
	Ratings	3A/250VAC F							
	Operate	(95 <sub>★</sub> 96 Clo		7- - 98 Open)					
Insulation resistan		5137 A 1 11	Min 100 № at						
Surge endurance (	<u>-</u>		e standard wave						
Fast transient burs		2kV							
Environment	Operation	-25~70°C							
Temperature	Storage	-30~80°C	No for and						
	Relative humidity	30~90%RH (		D 11=5	D 1/0 :==	D 11 = 0	D 1/0 : ==	D 1155	00 11 50
Trip indicator	w	Red LED	Red/Green LED	Red LED	Red/Green LED	Red LED	Red/Green LED	Red LED	2Red LEDs
Dimension(mm)	W×H×D	53×78×87.		53×68×87.	<b>5</b>	53×38×87.5	)	89×77.5×97	7.4
Mounting type			Direct mount onto a Metasol MC (MC-32a, 40a)  Separate mount (Screw or Din-rail)						

Note) 1. When it is 2CT modle, only two-phase protection is available 2. When power applied Aux. Contact operate

UL, cUL, CE

Certification

### **Specification**

### **GMP Series**

#### Ratings









M	odel	GMP60T	GMP60TE GMP60TA	GMP60-TD	GMP60-TDa	GMP60-3T(R)	GMP60-3TZ(R) GMP60-3TN(R)
Туре		Tunne	el type	Tunnel	type	Tunnel type	Tunnel type
No. of CT		20	T	2	CT	3CT	3CT
Protection	Overcurrent		)		•	•	•
	Phase failure		•		•	•	•
	Lock/Stall	•	•		•	•	•
	Phase unbalance	_	-		_	•	•
	Reverse phase	-	-		_	● (R Type)	● (R Type)
	Ground fault Note1)	-	_		_	_	•
Current setting rar	nge (A)	0.5~6, 3~	30, 5~60	9.0	5~60	0.5~60	0.5~60
Operating time cha	aracteristics	Defi	nite	De	finite	Definite	Definite
Time setting	D time	0.2~3	0 sec	1~6	0 sec	0.2~60 sec	0.2~60 sec
(sec)	O time	0.2~30 sec	5 sec (Fixed)	0.5~	30 sec	0.2~15 sec	3 sec (Fixed)
	A time (Reset)	_	0.2~120 Note4)	_	1~20 min	_	_
Tolerance		Current ±5%	Time ±5% (or:	±5 sec)			
Control power	Voltage Note3)	AC 110V/220	$(\pm 10\%)$ Note3)	AC 110V or 2	20V	AC 100V~260V	
	Frequency	50/60Hz					
Aux. contact	Contact Note2)	1SPDT (1c)		2SPST (1a1b	)		
	Ratings	1A/250VAC F	Resistive load	3A/250VAC F	Resistive load		
Insulation resistan	се	Min 100№	at 500Vdc				
Surge endurance (	IEC 61000-4-5)	5kV Apply the	standard wave				
Fast transient burs	st (IEC 61000-4-4)	2kV					
Environment	Operation	<b>-25~70</b> °C					
Temperature	Storage	<b>-30~80</b> °C					
	Relative humidity	30~90% RH (	No freezing)				
Trip indicator		Red LED		7 Segment		Red/Green × 2-Color LED	Red/Green × 2-Color LED, Red LED
Dimension(mm)	W×H×D	72×67×69		75×72.8×47	7	94.6×95×97	94.6×95×97
Mounting type		Separate mou	unt (Screw or Dir	n-rail)			
Certification		UL, cUL, CE					

Note) 1. 3TZ(R): Zero sequence CT type, 3TN(R): Residual curcuit 2. When power applied the Aux. contact operate 3. GMP60T/TE: AC24V, 48V or 380V, 50/60Hz types a option 4. GMP60TA: Auto Reset type

## **Specification DMP/IMP Series**







M	lodel	DMP∐-S/SZ/SI	DMP∐-Sa/SZa	DMP∏-T/TZ/TI	DMP∐-Ta/TZa	IMP-C-NO	IMP-C-A420	IMP-C-M485
Wiring		Screv	l v type	Tunne	el type		Tunnel type	
Panel mount		Unit or Extension	Note1)	I		Unit or Exte	ension	
Operation time		Inverse/Definite	Inverse/Definite			Thermal In	verse/Inverse/I	Definite
Protection	Over current	According to the s	According to the setting time			According	to the setting ti	me
	Phase failure	3 sec				1.5 sec		
	Reverse phase	Within 0.1 sec				Within 0.1	sec	
	Lock/Stall	Within 0.5 sec				Within 0.5	sec	
	Phase unbalance	5 sec				5 sec		
	Under current	3 sec				3 sec		
	Ground fault	Within 0.05~1 sec	. (DMP Z/Za Mode	)		Within 0.05~	-1 sec Note2)	
	Short circuit	Within 50ms (DMI	Within 50ms (DMPI Model)				ns	
Alarm		Variable (60~110% of the setting current)			Variable (60~110% of the setting current)		tting current)	
Current setting ran	nge (A)	6: 0.5~6A, 36: 3~3	86A, 60: 5~60A			0.5~100		
Time setting	Definite D time	0~60 sec				1~200 sec		
(sec)	O time	0~30 sec				1~60 sec		
	Inverse time	0~60 sec				1~60 sec		
	A time (Reset)	Manual reset				Manual res	set/Autometic	
Tolerance	Current	±5%				±5%		
	Time	±5% (or±0.5 sec	c)			±5% (or±	0.5 sec)	
Operating power	Voltage	AC 110V or 220V	50/60Hz			AC/DC 85	~245V, 50/60H	Z
Aux. contact		2a, 2b, 1a1b				OL: 1a1b,	AL: 1a	
Insulation resistan	ice	Over DC 500V 10	OMΩ			Over DC 5	00V 100MΩ	
Surge impulse vol	tage (IEC 61000-4-5)	5kV				5kV		
Fast transient burs	st (IEC 61000-4-4)	2kV				2kV		
Environment	Operation	<b>-25~70</b> °C				<b>-25~70</b> °C		
Temperature	Storage	-30~80°C			-30~80°C			
	Relative humidity	30~90% RH (No f	reezing)			30~90% R	H (No freezing	)
Display	7-Segment	3 phase current, c	3 phase current, cause of a fault		3 phase cu	ırrent, cause of	a fault	
	Bar-Graph	60~110% of real le	oad current			60~110% (	of real load cur	rent
Mounting type		35mm Din-rail/Pai	nel			35mm Din-	-rail/Panel	
Certification		UL, cUL, CE						

Note) 1. In extension type, the digital EMPR is calibrated with combining the display past and main body so, please cautious not to combine the display part and main body with different part No. 2. Zero current sensing by zero sequencee CT and Residual circuit.

### Inverse time characteristics

### GMP22/40 Type






#### **Description**

- Wide and adjustable current range
- Adjustable trip time (trip class 5-30)
- Designed suitable for use with contactors
   Directly mountable on the Metasol contactors (Pin type)
   Separate mount versions are also available
   Separately mountable on 35mm DIN rail or with screws
- 1NO : 1NO twin contacts
- 1NO+1NC trip contacts
- Manual reset as standard (Automatic reset optional)

#### Front face configuration

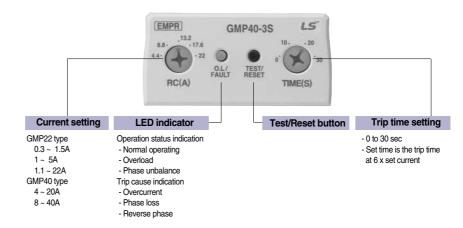







Certificate
CE, ULcUL

#### **Extended protective functions**

Types	(GMP22/40-□)	-2P, -2T, -2S	-3P, -3T, -3S	-3PR, -3TR, -3SR
Numb	er of sensors	2CT	3CT	3СТ
	Overcurrent	<b>✓</b>	<b>✓</b>	<b>✓</b>
	Phase failure	<b>✓</b>	<b>✓</b>	<b>✓</b>
Functions	Locked rotor	<b>✓</b>	<b>✓</b>	<b>✓</b>
	Phase unbalance		<b>✓</b>	<b>✓</b>
	Reverse phase			<b>✓</b>

Relay control voltage	100 to 260V AC 50/60Hz		
Auxiliary contact	3A/250VAC at resistive load		
Auxiliary contact	1NO (97-98) + 1NC (95-96)		
Setting tolerance	Current ± 5%		
Setting tolerance	Time $\pm$ 5% (or $\pm$ 0.5sec)		
Insulation resistance	Min 100 № at 500 V DC		
Impulse withstand voltage	5kV (IEC 61000-4-5)		
Fast transient burst	2kV (IEC 61000-4-4)		
Ambient temperature	-25 to 70°C for operation		
Ambient temperature	-30 to 80°C for storage		
Humidity	30 to 90% RH		

### **Inverse time characteristics**

### GMP22/40 Type



To mount on 35mm DIN rail



Cable connection part can be modified between screw connection and passing CT hole

#### **Selection (GMP22 Type)**

Mount/Connection	Sensor	Setting range	Catalog No.
Directly on a contactor	2-sensor	0.3 - 1.5A	GMP22 - 2P · 1.5
	(2 CT)	1 - 5A	GMP22 - 2P · 5
		4.4 - 22A	GMP22 - 2P · 22
	3-sensor	0.3 - 1.5A	GMP22 - 3P · 1.5
	(3 CT)	1 - 5A	GMP22 - 3P · 5
		4.4 - 22A	GMP22 - 3P · 22
	3-sensor	0.3 - 1.5A	GMP22 - 3PR · 1.5
	Reverse phase	1 - 5A	GMP22 - 3PR · 5
	detection	4.4 - 22A	GMP22 - 3PR · 22
Separate mount	2-sensor	0.3 - 1.5A	GMP22 - 2S · 1.5
	(2 CT)	1 - 5A	GMP22 - 2S · 5
Cable connection		4.4 - 22A	GMP22 - 2S · 22
with a screw	3-sensor	0.3 - 1.5A	GMP22 - 3S · 1.5
	(3 CT)	1 - 5A	GMP22 - 3S · 5
		4.4 - 22A	GMP22 - 3S · 22
	3-sensor	0.3 - 1.5A	GMP22 - 3SR · 1.5
	Reverse phase	1 - 5A	GMP22 - 3SR · 5
	detection	4.4 - 22A	GMP22 - 3SR · 22
Separate mount	2-sensor	0.3 - 1.5A	GMP22 - 2T · 1.5
	(2 CT)	1 - 5A	GMP22 - 2T · 5
Connection		4.4 - 22A	GMP22 - 2T · 22
without a screw	3-sensor	0.3 - 1.5A	GMP22 - 3T · 1.5
- cables pass	(3 CT)	1 - 5A	GMP22 - 3T · 5
through CT holes		4.4 - 22A	GMP22 - 3T · 22
	3-sensor	0.3 - 1.5A	GMP22 - 3TR · 1.5
	Reverse phase	1 - 5A	GMP22 - 3TR · 5
	detection	4.4 - 22A	GMP22 - 3TR · 22

#### **Selection (GMP40 Type)**







Mount/Connection	Sensor	Setting range	Catalog No.
Directly on a contactor	2-sensor	4 - 20A	GMP40-2P · 20
	(2 CT)	8 - 40A	GMP40-2P · 40
	3-sensor	4 - 20A	GMP40-3P · 20
	(3 CT)	8 - 40A	GMP40-3P · 40
	3-sensor	4 - 20A	GMP40-3PR · 20
	Reverse phase	8 - 40A	GMP40-3PR · 40
	detection		
Separate mount	2-sensor	4 - 20A	GMP40-2S · 20
	(2 CT)	8 - 40A	GMP40-2S · 40
Cable connection	3-sensor	4 - 20A	GMP40-3S · 20
with a screw	(3 CT)	8 - 40A	GMP40-3S · 40
	3-sensor	4 - 20A	GMP40-3SR · 20
	Reverse phase	8 - 40A	GMP40-3SR · 40
	detection		
Separate mount	2-sensor	4 - 20A	GMP40-2T · 20
	(2 CT)	8 - 40A	GMP40-2T · 40
Connection	3-sensor	4 - 20A	GMP40-3T · 20
without a screw	(3 CT)	8 - 40A	GMP40-3T · 40
- cables pass	3-sensor	4 - 20A	GMP40-3TR ⋅ 20
through CT holes	Reverse phase	8 - 40A	GMP40-3TR · 40
	detection		

#### **Definite time characteristics**

### GMP60-T(E) Type




#### **Description**

- Small size, economical
- Delay time setting in starting and operation
- Over current, phase failure protection
- Definite time characteristics
- Wide current setting range
- Screw or Din-rail mounting

#### **Extended protective functions**

	Types	GMP60-T	GMP60-TE	GMP60-TA
Nu	umber of sensors	2CT	2CT	2CT
	Overcurrent	<b>✓</b>	<b>✓</b>	<b>✓</b>
Functions	Phase failure Note1)	<b>✓</b>	<b>✓</b>	<b>✓</b>
runcuons	Locked rotor	<b>✓</b>	<b>✓</b>	<b>✓</b>
	Auto reset			<b>✓</b>



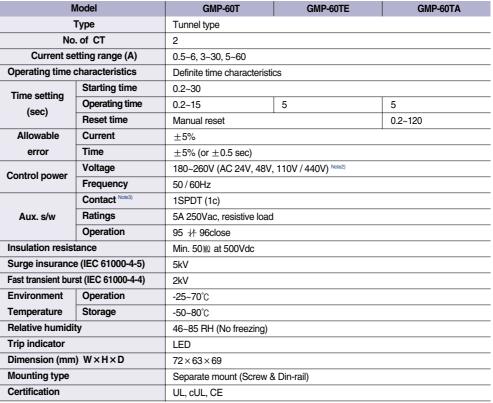



<sup>2. ( )</sup> are optional specifications3. When power applied the Aux. contact operate

#### Tunnel type EMPR protects the current under 0.1A

If we increase the number of times of a wire pass through the CT (Tunnel), the EMPR can detect the lower current

No. of times to pass through	Current setting range
1	0.5~6
2	0.25~3
3	0.17~2
4	0.12~1.5



Large current over 60A can be applied through additional current transformers

### **Ampere meter function**

### GMP60-TD(a) Type



#### **Description**

- Definte time characteristics
- Delay time setting in starting and operation
- Over current, phase failure protection
- Definite time characteristics
- Wide current setting range
- Screw or Din-rail mounting
- Display the causes of the fault and the values

#### **Extended protective functions**

Types		GMP60-TD	GMP60-TDa	
Number of sensors 2CT 2C		2CT		
	Overcurrent	<b>✓</b>	<b>~</b>	
	Phase failure Note1)	~	<b>✓</b>	
Functions	Locked rotor	<b>✓</b>	<b>✓</b>	
	Under current		<b>✓</b>	
	Auto reset		<b>✓</b>	

<sup>\*</sup> Only two-phase oretectuib is available.

#### Ratings (Tunnel type)

N	Model	GMP60-TD	GMP60-TDa	
Туре		Tunnel type		
No	. of CT	2		
Current se	tting range (A)	0.5~60		
Operating time	characteristics	Definite time characteristics		
Time setting	Delay time	1~60		
(sec)	Operating time	0.5~30		
(300)	Reset time	Manual reset	1~20min	
Allowable	Current	±5%		
error	Time	$\pm$ 5% (or $\pm$ 0.5 sec)		
Control power	Voltage	AC 110/220V		
Control polici	Frequency	50 / 60Hz		
	Contact Note2)	2SPST (1a1b)		
Aux. s/w	Ratings	5A 250Vac, resistive load		
	Operation	95 - ₩ 96close 97 - 1 98open		
Insulation resistance		Min. 50 № at 500Vdc		
Surge insurance	e (IEC 61000-4-5)	5kV		
Fast transient bur	st (IEC 61000-4-4)	2kV		
Environment	vironment Operation -25~70°C			
Temperature Storage		-50~80°C		
Relative humidity		46~85 RH (No freezing)		
Trip indicator		7-Segment		
Dimension (mm	) W×H×D	72×63×69		
Mounting type		Separate mount (Screw & Din-rail)		
Certification		UL, cUL, CE		

Note) 1. Under phase failure condition over current flows. The EMPR tripped if it is over the setting over current 2. When power applied the Aux. contact operate

#### Tunnel type EMPR protects the current under 0.1A

If we increase the number of times of a wire pass through the  $\operatorname{CT}$  (Tunnel), the  $\operatorname{EMPR}$  can detect the lower current

No. of times to pass through	Current setting range	Current Ratio
1	0.5~6	1
2	0.25~3	0.5
4	0.12~1.5	0.25

### **Definite time characteristics with 3CT**

### GMP60-3T(R) Type



GMP60-3T GMP60-3TR

#### **Description**

- Cable connecting through CT holes (option: with screw)
- Auxiliary contact: 2SPST (1a1b at energization)
- Wide and adjustable current range (0.5~60A)
- D-time: 0.2~60 sec. / O-time: 0.2~15 sec.
- Control voltage: AC100~245V 50/60Hz
- Manual(electrical) reset as standard
- Applicable to inverter at the secondary circuit (except GMP60-3TR)



Terminal Lug

#### **Extended protective functions**

	Types	GMP60-3T	GMP60-3TR
Numb	per of sensors	3СТ	3СТ
	Overcurrent	<b>✓</b>	<b>✓</b>
Duete etime	Phase failure	<b>~</b>	<b>✓</b>
Protective functions	Locked rotor	<b>~</b>	<b>✓</b>
idilotions	Phase unbalance	<b>~</b>	<b>✓</b>
	Reverse phase		<b>✓</b>
Storing th	e last fault cause	<b>~</b>	<b>✓</b>



Large current over 60A can be applied through additional current transformers

#### Selection

Mount/Connection	Optional function	Setting range	Catalog No.
Separate mount	None	0.5 - 60A	GMP60-3T
· Cable Connection			
through CT holes	Reverse phase	0.5 - 60A	GMP60-3TR

Mounting	On 35mm rail or panel with screws	
Setting tolerance	Current ± 5%	
Setting tolerance	Time $\pm$ 5% (or $\pm$ 0.5sec)	
Frequency	50/60Hz	
Auxiliary contact rating	5A/250VAC at resistive load	
Insulation resistance	Min 100 № at 500 V DC	
Surge insurance	5kV (IEC 61000-4-5)	
Fast transient burst	2kV (IEC 61000-4-4)	
Ambient temperature	-25 to 70°C for operation	
Ambient temperature	-30 to 80°C for storage	
Humidity	30 to 90% RH	
Operating indication	Red/Green 2-color LED, Red LED	
Standard	dard UL508, IEC60947-1	

### For ground fault current protection

**Description** 

### GMP60-3TZ(R), 3TN(R) Type



GMP60-3TZ, 3TZR GMP60-3TN, 3TNR

### Extended protective functions

- Control voltage: AC100~245V (50/60Hz)

- Cable connecting through CT holes

- Definite time characteristics D-time: 0.2~60sec. / O-time: 3sec.

- With 3 sensors (CT)

- Auxiliary contact: 2SPST (1a1b at energization)- Wide and adjustable current range (0.5~60A)

Types		GMP60-3TZ, 3TN	GMP60-3TZR, 3TNR
Numb	er of sensors	зст	3СТ
	Overcurrent	<b>✓</b>	<b>✓</b>
	Phase failure	<b>✓</b>	<b>✓</b>
Protective	Ground fault	<b>✓</b>	<b>✓</b>
functions	Locked rotor	~	<b>✓</b>
	Phase unbalance	<b>✓</b>	<b>✓</b>
	Reverse phase		<b>✓</b>
Storing th	e last fault cause	<b>✓</b>	<b>✓</b>



Terminal Lug

#### **Selection**

Mount/Connection	Ground fault current	Optional function	Setting range	Catalog No.
	Zero phase current			
<ul> <li>Separate mount</li> </ul>	(0.1~2.5A)	None	0.5 - 60A	GMP60-3TZ
· Cable Connection	*ZCT required			
through CT holes		Reverse phase	0.5 - 60A	GMP60-3TZR
	Residual current			
	(0.5~6A)	None	0.5 - 60A	GMP60-3TN
		Reverse phase	0.5 - 60A	GMP60-3TNR

Note) Use ZCT for EMPR, 100mA/40  $\sim 55 mV$ 

Marria	0-05
Mounting	On 35mm rail or panel with screws
Setting tolerance	Current ± 5%
Setting tolerance	Time $\pm$ 5% (or $\pm$ 0.5sec)
Frequency	50/60Hz
Auxiliary contact rating	5A/250VAC at resistive load
Insulation resistance	Min 100 № at 500V DC
Surge insurance	5kV (IEC 61000-4-5)
Fast transient burst	2kV (IEC 61000-4-4)
Ambient temperature	-25 to 70°C for operation
Ambient temperature	-30 to 80°C for storage
Humidity	30 to 90% RH
Operating indication	Red/Green 2-color LED, Red LED
Standard IEC 61000, KEMC 1120	

### Inverse time characteristics


### **GMP80 Type**



#### **Description**

- Wide and adjustable current range
- Adjustable trip time (trip class 5-30)
- Separately mountable on 35mm DIN rail or with screws
- 1NO+1NC trip contacts
- Manual reset as standard (Automatic reset optional: GMP80-2SA)

#### Front face configuration

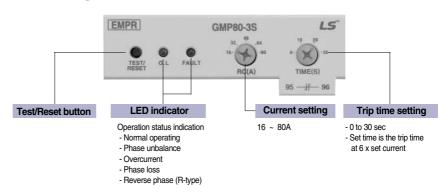



#### **Extended protective functions**

Types (GMP80-□)		2S	2SA	38	3SR
Number of sensors		2CT	2CT	3CT	3CT
	Overcurrent	<b>✓</b>	<b>✓</b>	<b>~</b>	<b>~</b>
	Phase loss	<b>✓</b>	<b>✓</b>	<b>~</b>	<b>✓</b>
Functions	Locked rotor	<b>✓</b>	<b>✓</b>	<b>~</b>	<b>✓</b>
	Phase unbalance			<b>~</b>	<b>✓</b>
	Reverse phase				<b>✓</b>
	Auto reset		<b>✓</b>		

#### Selection

Mount/Connection	Sensor	Setting range	Catalog No.
Separate mount	2-sensor	16 - 80A	GMP80-2S
	(2 CT)		
Cable connection	3-sensor	16 - 80A	GMP80-3S
with a screw	(3 CT)		
	3-sensor	16 - 80A	GMP80-3SR
	Reverse phase detection		

Relay control voltage	100 to 260V AC 50/60Hz
Auxiliary contact	3A/250VAC at resistive load
	1NO (97-98) + 1NC (95-96) (When power applied)
Setting tolerance	Current ± 5%
	Time $\pm$ 5% (or $\pm$ 0.5sec)
Insulation resistance	Min 100 № at 500 V DC
Surge insurance	5kV (IEC 61000-4-5)
Fast transient burst	2kV (IEC 61000-4-4)
Ambient temperature	-25 to 70°C for operation
	-30 to 80°C for storage
Humidity	30 to 90% RH



### **Characteristics DMP Series**

### DMP-S(a)/SZ(a)/SI Type



- Unit type or extension type is available
- Extension type: Remotely mounts the display unit on the panel surface
- Ampere meter function: current and setting value by press the display button
- Select the inverse time or definite time
- Display the causes of the fault and the values
- Load ratio is displayed up to setting current

#### **Protect function**

Over current	Depend on setting time	Selectable the inverse/definite
Phase failure	Within 3seconds	Over 70% of the rate of unbalance
Phase unbalance	Within 5seconds	Over 50% of the rate of unbalance
Reverse phase	Within 0.1seconds	Function enable
Stall	Within 5seconds	Over 180% of the setting current
Lock	Within 0.5seconds	Setting 200~900% of rated current
Under current	Within 3seconds	Setting 30~70% of rated current

Note) Lock protection is operated after setting D-time in case of definite time type



Extention type (with cable)

#### **Function selection**

FUNC	Sel	Description
1. CHA	Inv/dEF	Operating characteristics setting (Inverse/definite time type)
2. dEF Note1)	0~30 (S)	Setting the operating time (In definite type)
3. r.P	oFF/on	Reverse phase enable
4. Und	oFF/30~70 (%)	Under current enable and setting
5. Alt	oFF/60~110 (%)	Alerting enable and setting
6. Stl	oFF/on	Stall enable
7. Loc	oFF/200~900 (%)	Lock enable and setting
8. Ct	1~120	CT ratio setting
9. P.F	on/oFF	Phase fault enable
b. StA Note2)	0~120	Operating time setting by month
c. StH	10~730	Operating time setting by hour
d. tAH	A000,000.0	Displaying total operating time (month, hour)
E. rAH	A000,000.0	Displaying operating time (month, hour)
Sto	Sto	Store

Note) 1. 2.dEF is only displayed when dEF is selected in a 1.CHA mode 2. Functions for b to e are available for only Sa & SZa type.

· iaiiigo				
Model		DMP∐-S/Sa	DMP∐-SZ/SZa/SI	
Туре	Type Wiring method Panel mount		Sc	rew
			Unit or E	extension
Operating charac	teristics		Inverse/definite type	
Alerting function			Variable between	en 60 and 110%
Current range (A)	)		06: 0.5~6, 36: 3~36, 60: 5~60	
Setting time	Definite	Delay (D-T)	0~60s	econds
Operating (O-T) 0~30seconds		econds		
	Inverse		0~60seconds	
Reset type			Manua	al reset
Operating	Voltage		AC 110V c	or AC 220V
voltage	Frequen	у	50/6	60Hz
Aux. contacts	OL	2-SPST (95~98)	3A/250Vac ı	resistive load
	AL	SPST (07-08)	3A/250Vac resistive load	
Indicate	7-segme	nt	3-phase current value, fault cause	
	Bar-LED	arrays	Load ratio (60~110%)	
Mounting			35mm Din-rail/Panel	
Certification			UL, cUL, CE	

### **Characteristics DMP Series**

### DMP-T(a)/TZ(a)/TI Type



- Unit type or extension type is available
- Extension type:Remotely mounts the display unit on the panel surface
- Ampere meter function: current and setting value by press the display button
- Select the inverse time or definite time
- Display the causes of the fault and the values
- · Ground fault protect function is added

#### **Protect function**

Over current	Depend on setting time	Selectable the inverse/definite
Phase failure	Within 3seconds	Over 70% of the rate of unbalance
Phase unbalance	Within 5seconds	Over 50% of the rate of unbalance
Reverse phase	Within 0.1seconds	Function enable
Stall	Within 5seconds	Over 180% of the setting current
Lock	Within 0.5seconds	Setting 200~900% of rated current
Under current	Within 3seconds	Setting 30~70% of rated current
Ground fault Note)	Selectable	Grounded current setting by dip s/w
Ground lault wile)	0.05~1.0seconds	(100~2500mA)

Note) Lock protection is operated after setting D-time in case of definite time type



Extention type (with cable)

#### **Function selection**

FUNC	Sel	Description
1. CHA	Inv/dEF	Operating characteristics setting (Inverse/definite time type)
2. dEF Note1)	0~30 (S)	Setting the operating time (In definite type)
3. r.P	oFF/on	Reverse phase enable
4. Und	oFF/30~70 (%)	Under current enable and setting
5. g-F	oFF/0.05~1.0 (S)	Ground fault enable and setting
6. Stl	oFF/on	Stall enable
7. Loc	oFF/200~900 (%)	Lock enable and setting
8. Ct	1~120	CT ratio setting
9. P.F	on/oFF	Phase fault enable
A. gFd Note2)	oFF/on	Setting delay of ground fault
b. StA	0~120	Operating time setting by month
c. StH	10~730	Operating time setting by hour
d. tAH	A000,000.0	Displaying total operating time (month, hour)
E. rAH	A000,000.0	Displaying operating time (month, hour)
Sto	Sto	Store

Note) 1. 2.dEF is only displayed when dEF s selected in a 1.CHA mode 2. Functions for b to e are available for only SZa & TZa type.
3. Ground fault sensitive current selection: TZa type

3				
Model		DMP <u></u> -T/Ta	DMPTZ/TZa/TI	
Туре	Wiring method		Tur	nel
	Panel mou	Panel mount Unit or Extension		xtension
Operating charac	cteristics		Inverse/definite type	
Alerting function			Variable between	en 60 and 110%
Current range (A	)		06: 0.5~6, 36: 3	3~36, 60: 5~60
Setting time	Definite	Delay (D-T)	0~60seconds	
	Operating (O-T) Inverse		0~30seconds	
			0~60seconds	
	Reset type	•	Manual reset	
Operating	voltage		AC 110V o	r AC 220V
voltage	Frequency	1	50/6	0Hz
	ZCT input	(07-08)	200mA/110mV (ZC	[30 ø , 50 ø , 65 ø , 80 ø ]
Aux. contacts (2a	a, 2b, 1a1b)	OL, GR 2-SPST (95~98)	3A/250Vac resistive load	
Indicate	7-segmer	nt	3-phase current value, fault cause	
	Bar-LED a	rrays	Load ratio (	60~110%)
Mounting	ing		35mm Din-rail/Panel	

### **Characteristics IMP Series**

### **IMP-C Type**



- $\bullet$  MODBUS RS-485 Communication or 4~20mA analogue output
- 3 phase ampere meter function: Check the 3 phase current and setting value by press the display button
- Select the Thermal inverse/inverse time or definite time
- Easy to operate: Set the most function by the operation button and knob
- Display the causes of the fault and the values
- Adjustable wide current range (0.5~100A)

#### **Protect function**

Over current	Depend on setting time	Selectable the inverse/definite
Phase failure	Within 1.5seconds	Over 70% of the rate of unbalance
Phase unbalance	Within 3seconds	10~70% of the rate of unbalance
Reverse phase	Within 0.1seconds	Function enable
Stall	Within 3seconds	setting 150~500% of rated current
Lock Note1)	Within 0.5seconds	Setting 200~800% of rated current
Under current	Within 3seconds	Setting 30~90% of rated current
Ground fault Note2)	Selectable 0.05,	gF: 0.03/0.05/0.1~3A
	0.1~1.0seconds	gn: 20~500% of the FLC min

Note) 1. Lock protection is operated after setting D-time in case of definite time selected. 2. 12. gF Zero sequence CT, 13. gn Residual circuit sensing.



Extention type (with cable)

#### **Setting Menu (A Group)**

Menu	Setting Value	Item	Default Value
1.CHA	dEF/th/n-th	Operation Characteristics (Definite Time / Heat Accumulation Inverse Time /Inverse Time)	n-th
2.O-t	1~60s	Operation Time (sec)	60
3.d-t	1~200s	Operation Delay (sec)	In chase of dEF
4.r-C	0.5~10A/5~100A	Rated Current	Max.
5.Ctr	0.25, 0.5, 1~200	CT Ratio (4 times, twice, once)	1
6.Loc	OFF, 200~800%	Lock Protection (sec)	OFF
7.StL	OFF, 150~500%	Stall Protection (sec)	OFF
8.P-F	OFF/On	Open Phase	OFF
9.P-U	OFF, 10~70%	Unbalance Protection (%)	OFF
10.rP	OFF/On	Reverse Phase	OFF
11.UC	OFF, 30~90%	Low Current Protection (%)	OFF
12.gF	0FF, 0.03, 0.05/0.1~3A	Ground Fault Operation Current (Zero-Phase-Sequence Current) (A)	OFF
13.gn	OFF, 20~500% (FLCmin)	Ground Fault Operation Current (Post-Arc Current) (FLCmin)	OFF
14.gt	0.05, 0.1~1.0s	Ground Fault Operation Time (Current)	-
15.gd	On/OFF	Ground Fault Delay During Start	ON
16.IC	OFF, 500~1000%	Instantaneous Protection (%)	OFF
17.lo	ALt/TriP	Instantaneous Warning/Operation	TriP

### Note) 1. When the rated current S/W is 100A, the CT ratio is not displayed. 2. Some menus are not displayed if relevant functions are not available.

### Setting Menu (B Group)

Menu	Setting Value	Item	Default Value
1.E-r	On/OFF	Electric Recovery	On
2.A-r	OFF, 1~20 min	Automatic Recovery (Minute)	OFF
3.r-t	Hour/Minute	Operation Time	Time Check
4.Srt	OFF, 1~8760Hour	Operation Time Setup (Hour)	-
5.s-d	2009/01.01/00:00	YY/MM/DD/ HH:MM	-
6.Trt	Day/hour:minute	Total Operation Time	Time Check
A.t-d	0.5~10/5~100A	20mA Output Setup	A420
A.Adr	1~247	Communication Address	
b.bps	96/192/384	Communication Speed	M485 Model
c.S-P	On/OFF	SWAP	

- Note) 1. When the power is supplied first or is resupplied after a power failure, must set up the date (5.S-d).
  - 2. Automatic recovery is only possible in case of an excess current trip.

Model			IMP-C-NO, M485, A420	
Туре	Wiring me	ethod	Tunnel	
	Panel mo	unt	Unit or Extension	
Operating chara	cteristics		defin/TH-Inv./n-TH	
Alerting function	1		Variable between 60 and 110%	
Current range (A	4)		0.5~100	
Setting time	Definite	Delay (D-T)	1~200seconds	
		Operating (O-T)	0~30seconds	
	Inverse/Ti	H-Inverse time	0~60seconds	
	Reset type	е	Manual reset	
Operating	voltage		AC 85~245V, 50/60Hz	
	ZCT input	(07-08)	200mA/110mV (ZCT) [30 ø , 50 ø , 65 ø , 80 ø]	
Aux. contacts (2	a, 2b, 1a1b)	OL, GR 2-SPST (95~98)	5A/250Vac resistive load	
Indicate	7-segmer	nt	3-phase current value, fault cause 5point	
	Bar-LED a	arrays	Load ratio (60~110%)	
Mounting			35mm Din-rail/Panel	
Communication			A420: Analog, M485: Modbus	
Certification			CE	

### **Setting method**

#### **GMP Series Inverse time**

#### 1. Check the rated voltage and apply the control power to A1 and A2 terminal

#### 2. Check the TEST/RESET button

- 1) When you press the 'Test/Reset' button, the O.L LED is turned on and the EMPR is tripped
- 2) When you press the 'Test/Reset' button under the EMPR is tripped, the O.L LED is turned off and the EMPR is reset
- 3) Auto reset function: When it is tripped by the over current, it is reset after 1 Min.(Optional)

#### 3. Set the operating time

The operating time is set on the base of 600% of the rated current in the characteristic curve

- Set the operating time by considering the operating time and start current according to the types of the load
- 2) If the time knob is set to 10sec, the EMPR is tripped when the start current (600% of the rated current) is applied for 10sec

Caution) The EMPR with inverse time characteristics can be tripped to protect the motor when the motor is started a few times continuously When a motor is frequently changing the rotating direction (forward and reverse), set the operating time longer For the crane and hoist use, select the EMPR with definite time characteristics

#### 4. Set the operating current

Set the current by considering the rated current of a motor to protect from the over current

- 1) Check the rated current of a motor is within the current setting range of an EMPR
- 2) Set the 'RC' (Rated current) knob to the maximum value and then start a motor
- 3) Under normal motor operation, rotate the 'RC' knob to the counterclockwise until the 'O.L' LED flickers The current at this point in the 100% current rating under real load
- 4) At this point, rotate the 'RC' knob to the clockwise until the 'O.L' LED turned off. Ex) When the 'O.L' LED flickering at 20A, the setting current will be 22A(=20x1.1) Note) The brackets for connection is offered standard

#### 5. Check status of operation by LED

1) In case of overcurrent

If there will be an overcurrent during motor operation, the red color of LED will flicker at 0.4 second intervals. After tripping because of overcurrent, the red color of LED will light up.

2) In case of phase failure

If there will be a phase failure in three phase load, it will be tripped within 3 seconds.

Note) 2CT EMPR can protect motor from R or T phase failure.

3) In case of phase unbalance

If phase unbalance rate is over 50%, FAULT LED will flicker 0.4 second intervals.

4) In case of Reverse phase

Red & green color LED will flicker alternately.

	Condition		LED Status	LED Diagram	Remark	
Ope	Normal		LED OFF			
Operating st	Wating Over current		0.4 Second intervals	ШШШ		
atus	Phase unbalance (30~50%)		0.4 Second intervals	<u> </u>	GMP 80-3S/3SR model, only red color LED will flicker.	
		Over current	O.L LED light up			
	Phase	R	1 time for 3 seconds			
Tripped status	S e failure		2 time for 3 seconds		GMP 80-3S/3SR model, O.L LED will light up and also FAULT LED will flicker.	
status	T T d status		2 time for 3 seconds	III III		
	Phase failure (2CT)		Red LED light up for 0.9 sec LED goes off for 0.1 sec	0.9 10.1		
	Reverse phase (3CT)		Red & Green color LED flicker alternately		GMP 80-3S/3SR model, Red/Green LED will flicker.	
	List There are two and activities for O.L. (Overland) a Facilities the model of OMPON 00/0D					

Note) There are two red color LEDs for O.L (Overload) & Fault in the model of GMP80-3S/SR  $\,$ 

### **Setting method**


#### **GMP Series Definite time**

#### **Tunnel type mounting**

#### 1. Check the Test/Reset button operation

- 1) Check if the wiring is correct (Refer to the wiring diagram)
- 2) Set the 'D-Time' and 'O-Time" knob to the min. ratings
- When the 'Test' button is pressed under tripped condition, the 'O.L' LED is turned off

Note) In operation, even though you press the 'Test/Reset' button, the EMPR do not trip

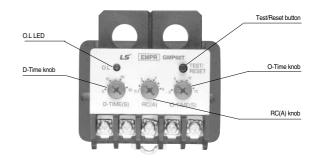


#### 2. Set the operating time

#### • D-time (Delay time): 0.2~30 sec

The motor starting current, which flows when the motor is starting, is generally 600% of the rated current. It is the time during which the EMPR do not operated by over-current during the starting time

- 1) Set the delay time by use of the 'D-time' knob
- 2) In case you do not know the delay time, start the motor by setting the 'D-time' knob to the max. position and after checking the time during which the staring current become stable, set the D-time (In general, the setting time is 3~5 seconds)
- The operating time is the time during which the EMPR tripped by the over-current. The EMPR is tripped after the selected operation time
- 1) Set the operation time by the 'O-time' knob
- 2) If you set the 'O-time' to the min value, the EMPR is tripped at once


Note) Generally set it to 4~6 seconds



Definite time characteristics curve

#### 3. Set the operating current

- 1) Start the motor by setting the 'RC' knob to the maximum position
- 2) Under operating condition, rotate the 'RC' knob to the counterclockwise until the 'O.L' LED turned on & off. The current at this point is the value (100%) under real load condition
- 3) Rotate the 'RC' knob to the clock-wise until the 'O.L' LED turned off. Ex) When the 'O.L' LED flickering at 20A, the setting current will be 22A(=20x1.1)



(ex: When the 'O.L' LED settings at 21A, the setting current will be 23A (=21\*1.1))

#### 4. Check the LED condition when operation

#### 1) Over-current

- The EMPR is not tripped during the D-time under over-current but the O.L LED turned on and off to indicate that the over-current flows
- If the EMPR is tripped after D-time the O.L LED turned on

Condition	Red O.L LED		Note
Operation normal	Off		
Overcurrent	Flicker		
Trip over-current	On		The EMPR is tripped

### **Setting method**

GMP60-TD(a) Type



#### Function & Setting menu

- 1) Automatic reset setting will work in the event of overcurrent trip
- 2) Func. A and b are to check the elapse time, not for setting
- 3) Undercurrent protection function will work at the current flow more than 0.4A
- 4) In case of changing the rating DIP S/W FUNC #1 should be changed accordingly
- 5) Function setting is allowable at TEST mode
  - Turn off the power before changing a current type switch, and then be sure to adjust the current in the menu

#### Setting Menu

FUNC	SEL	Description	Remarks
I EE4	68/60R	Current type selection	Set the same with rated current S/W
50-F	0.5/I~30(SEE)	Trip time setting	-
3.d-E	1~60/1(SEC)	Time delay setting	-
4[	0.5~6.0/5~60	Rated current setting	-
SEEr	0.25/0.5/1~120	Current ratio setting	-
EP-F	oFF/on	Phase loss enable	-
תט-נ	oFF/30~70(%)	Undercurrent setting	For TDa model only
BR	oFF/1~20(MIN)	Automatic reset setting	For TDa model only
9.5rE	oFF/10~8760	Operation hour setting	For TDa model only
RECE	-	Total running hour check	For TDa model only
b.r - E	20	Running hour check	For TDa model only
Sto		Store	-

Note) 1. If operation hour set at (15c) is elapsed (1c) is displayed and the relay operates normally. (There is no additional relay output)

<sup>2.</sup> How to check and Ltt

Display						
ErE	Press SEL	Day displayed	Press SEL Hou		Hou	r, Min displayed
	Press SEL	Operation hour di	splayed	Pres	s SEL	Day displayed
r-Ł	Press SEL	Min displayed				

<sup>3.</sup> When power is OFF the data in unit of minute is deleted at

#### • Fault status configuration

Protection	FND	Description	Remarks
Over current	0 - L	More than set current : Within the set time	
Undercurrent	U-C	Lower than the undercurrent set ratio : Within 3S	GMP60TDa
Phase Loss	PF - r	Over 70% of the rate of unbalance : Within 3S	R Phase Loss
Fliase Loss	PF-t	Over 70% of the rate of unbalance : Within 3S	T Phase Loss
LOCK	Loc	More than lock set current ratio : Within 1S	
Approaching Running Time	OrH	When Running time approaches at setting time	GMP60TDa

Note) When the 'FUN' Key and 'SEL' Key are pushed simultaneously, a last trip cause appears on the disply window.

Operation hour at is the total running hour before the motor is oFF and displayed in Day, Hour and Min. When motor is OFF the data is deleted.

### **Setting method**

### GMP60-3TZ(R) / 3TN(R) Type

#### • Trip curve: definite time characteristics

#### Protective function: overcurrent, locked rotor, phase loss, phaseun balance, ground fault (and phase reverse)

- 1) Overcurrent: trip within 3 sec. after D-time at 105% or more
- 2) Locked rotor: trip within 1 sec. after D-time at 300% or more
- 3) Phase loss: trip within 3 sec. (phases unbalance rate over 70%)
- 4) Phase unbalance: trip within 5 sec. (phases unbalance rate over 50%)
- 5) Ground fault: trip within 0.5 sec. after D-time at over 110% or under 90% of set value
- 6) phase reverse: trip within 1 sec. when any two phases out of three


#### Overcurrent trip time

- 1) Time delay(D-time) setting: between 0.2-60 sec.
- 2) Trip time(O-time) setting: fixed at 3 sec.

#### • Last fault cause data stored

- to display it press TEST/RESET button 2 times within 0.5 sec.
- PWR LED flicking in case of no fault

Note) In case of load less than minimum rating of EMPR make the number of penetrating through CT more than 2 times. If not, error may happen to phase loss .



Note) 1. Make power off before changing the rated current with S/W ①
2. The setting range of RC (A) KNOB @ is recognized as 0.5 = 6A or 5 ~

- 60According to the setting value of S/W ①. The value of the scale for RC (A) KNOB ⑥ is 0.5, 1, 2, 3, 4, 5, 6 or 5, 10, 20, 30, 40, 50, 60(A) from the left.
- 3. Last fault cause function indicates the LED status for the last TRIP.

#### Status of LED configuration

NO	Function	Setting	Description	Remark
1	6A/60A	Slide switch	Maximum rated current (6A/60A) setting	-
2	PWR.	Red LED	Lights up when power is ON	Blinking in the failure mode
3	FAULT	Red / Green LED	Overcurrent / unbalance in progress:  Overcurrent TRIP:  Phase loss (unbalance) TRIP  R-phase:  - S-phase:  - T-phase:  Reverse phase:	Red LED Green LED
4	GF	Red LED	Lights up after blinking in the event of ground fault	-
(5)	D-TIME (S)	KNOB	Delay time (0.2 to 60 sec.)	-
6	RC (A)	KNOB	Rated current setting: 0.5~6A/5~60A	-
7	⑦ GR (A) KNOB		Sensitivity current setting (0.1~2.5A)  Sensitivity current setting (0.5~6A)	Zero phase current detection type  Residual current detection type
8	TEST/RESET	BUTTON	TRIP / RESET alternately perform  1. Check relay contacts - displays fault cause  2. RESET	Pressing 2 times within 0.5 sec. the final failure cause is displayed

### **Setting method**

#### **DMP Series**

#### 1. Check the operation of the Test/Reset button

- 1) Check the wiring method
- 2) Press the Test/Reset button and then test is displayed on the LED and the DMPR is tripped
- 3) Press the Test/Reset button again and then it is reset


Note) The Test/Reset is not available when a motor is rotating.



#### 2. Shift the mode by pressing the FUNC key and then select the values by the Sel key

- 1) First shift to the test mode by press the "Test/Reset" button and then set the functions by press the "FUNC" button
- 2) Each time you press the FUNC button, the function mode switches from 1.CHA mode to Sto mode. When the mode that you want to change is displayed, push the "Sel" button to select the value you want. After you select the value, press the "FUNC" button to finish the settings and it displays the next mode
- 3) If no button is pressed in the selection mode, it remains in that mode
- 4) If you select the inverse time characteristics it skips the mode 2 (Definite O-time) and go to the mode 3 (Reverse phase)
- 5) Alt is the alert setting mode. It displays the load rate of the current setting value by the bar LED (60~110%)
  - If the current is higher than the setting value, the bar LED is switched on and off and the AL relay (07-08) make close and open in 1sec interval unit the EMPR is tripped (Prealarm function)
  - If the 5. Alt mode is set to off, the AL relay make close after the EMPR is tripped (Normal open contact)
- 6) To finish the settings you have to press the "Sel" button in the Sto mode

#### **Alarm signal (Alert function)**



#### **Setting Menu**

FUNC	Sel	Functions	Note
RH2.1	l nu/dEF	Inverse or definite time characteristics	Default is inverse time characteristics
335.S	0~30	Set the O-time (Definite time only)	For D-time setting, use the time knob
3. c.P	oFF/on	Reverse phases protection	Default is "Off"
<b>Y.Und</b>	oFF/30~70(%)	Under current protection	Default is "Off" Note1)
S.ALE	oFF/60~110(%)	Alarm function (With pre-alarm function)	Default is "Off"
5.9 - F	oFF/0.05~1(5EC)	Ground fault and Setting the operating time	Default is "Off" (Z type)
<b>6.5</b> € L	oFF/on	Stall function	Default is "Off"
7Loc	oFF/200~900(%)	Lock function	Default is "Off"
8. CE	I~120	CT ratio	Default is 1:1 Note2) (DMP06 Modle)
§9.P - F	on/oFF	Phase failure	Default is "On" to store
8.9Fd	oFF/on	Setting delay of Ground Fault	Available for SZa/TZa
<u> </u>	0~120	Operating time setting (Month)	
<u>c.5</u> ŁX	10~730	Operating time setting (Hour)	
d:EAH	R000,000.0	Displaying total operating time (Month, Hour)	DIVII _ Od 1 d OZd 1 Zd 11loudi
₹E.−AH	R000,000.0	Displaying operating time (Month, Hour)	
\$ 5Ło	Sto	Store	Push the SEL button to store

Note) 1. Set the under current value from above 350mA

2. Do not change the CT ratio in 36, 60 type

### **Setting method**

#### **DMP Series**



450

#### 3. Adjust the operating time by the time knob

#### • Inverse time characteristics

- Select the inverse time in the 1. CHA mode, the default operating time is 600% of the setting current
- 2) The setting range of the operating time is 0~60sec. Set the time by considering the motor start time
- 3) When it is over the setting time, the EMPR operate in accord with the hot characteristics curve

#### • Definite time characteristics

- 1) Select the definite in the 1. CHA mode, it is operated by the definite time characteristics
- 2) D-time means the time that delays the operating time when the motor is starting
- 3) The setting range of the operating time is 0~60sec. Set the time by considering the motor start time
- 4) Set the O-time at the setting mode 2. dEF and the range is 0~30sec

#### 4. Adjust the operating current by the current knob


- 1) Set the operating current based on the rated current that is described in the name plate. Generally set the 110~115% of the real load current in the normal load condition
- 2) There are 3 types according to the current range (6 / 36 / 60). When you use the external CT you can see the real current by setting the CT ratio
- 3) You can easily set the current value by refer to the load rate which is displayed on the bargraph (Approx. 90% load rate)


#### 5. Check the setting state by the display key


- 1) In normal condition it display the maximum current among the three phase current
- 2) Each time you press the "Display" button you can see the current and values
- 3) If no button is pressed for 3~4 seconds. It returned to the normal condition

#### 6. Check the causes of the fault by look at the display unit

The causes of the fault is switched on and off for 0.5sec interval. If you press the "Display" button at this time, you can see the values and the causes of the fault







#### Zero current sensitivity setting

Sensitivity	DIP S/W				
(mA)	1	2	3	4	
100	0	0	0	0	
200	1	0	0	0	
500	0	1	0	0	
1000	0	0	1	0	
1500	0	0	0	1	
2000	0	0	1	1	
2500	1	1	1	1	

Note) 1. Please use ZCT for LS EMPR

#### **Operation and Setting**

#### **IMP Series**





#### 1. Test/Reset

- 1) Check wires.
- 2) Press the Test/Reset key once. Then "TEST" is displayed and the EMPR is tripped.
- Press again the Test/Reset key to reset the EMPR. Note) While the motor is running, the Test/Reset key does not work.

#### 2. Setting

- 1) Press the Test/Reset key once. Then "TEST" is displayed and the EMPR is tripped.
- 2) Press the Enter key. Then "P-99" is displayed. Use the Up/Down keys to change the password.
- 3) Press the Enter key to enter A-gr setup mode. Use the Up/Down keys to select a group and Press the Enter key to enter the selected group. Press the Test/Reset key to move back to the previous mode.
- 4) In the A-Grp mode, Press the Enter key. Then "1.CHA" is displayed.

  Use the Up/Down keys to select an item and Press the Enter key to enter the selected item.

  Press the Test/Reset key to move back to the previous mode.
- 5) Use the Up/Down keys to set up the value and Press the Enter key to save it. Note) When the power is supplied first or is resupplied after a power failure, must set up the date in b-gr, 5.S-d. Set up the rated current S/W while the power is off.

#### 3. Quick Setup

- 1) Press the "Up and Enter" keys at the same time. "UPLD" is displayed and settings are uploaded to the display.
- 2) Insert the display to the body without settings, and then press the Test key to enter the test mode.
- 3) Press the "Down and Enter" keys at the same time. "TEST" is displayed and downloading is completed.
- Press the Test key to return to the normal mode. Note) Communication settings cannot be uploaded or downloaded.

#### 4. Setting Checkup

- 1) Press the Enter key.
- 2) Use the Up/Down keys to select a group and Press the Enter key to enter the selected group. Press the Test/Reset key to move back to the previous mode.
- 3) Use the Up/Down keys to select an item and Press the Enter key to enter the selected item.
- 4) Press the Enter key again to check settings.

#### 5. Failure Event Checkup

- 1) Press the Up and Down keys at the same time to display "1.O-C" (recent failure events). Note) When no failure events are stored, "1.non3" is displayed.
- 2) Use the Up/Down keys to select an event and press the Enter key to go to the selected event.
- 3) The R-phased failure current is displayed. Every time the Down key is pressed, S-phased failure current, Tphased failure current, overload rate and date are displayed one after the other.
- 4) Press the Test/Reset key to move back to the previous mode.
- 5) Press the Up and Down keys at the same time to get out of the failure event checkup mode.

#### 6. Forced Thermal Reset

When the system is tripped while it is in the thermal inverse time mode, if you want to turn the EMPR into the cold mode by resetting the motor's heat amount, Press the Enter and Test/Rest keys at the same time.

\* When a trip occurs due to the thermal excess current, if the motor is started right after it is reset, as the motor is hot, it is highly likely that the motor is tripped again.

### **Operation and Setting**

### **IMP Series**





#### **Setting Menu (A Group)**

Group	Menu	Setting Value	Description	Default Value
A	I.CHA	dEF/th/n-th	Operation Characteristics (Definite/Thermal Inverse/Inverse)	n-th (Inverse)
	2.0 - E	1~60s	Operation Time (sec)	60
	3.d-E	1~200s	Delay Time (sec)	200
	4[	0.5~10A/5~100A	Rated Current (10/100A)	10/100A
	5.C t r	0.25, 0.5, 1~200	CT Ratio (4 times, twice, once)	1 Note)
	6.Loc	OFF, 200~800%	Lock Protection (sec)	OFF
	7.5EL	OFF, 150~500%	Stall Protection (sec)	OFF
	8.P-F	OFF/On	Open Phase	OFF
	9.P-U	OFF, 10~70%	Unbalance Protection (%)	OFF
	10.cP	OFF/On	Reverse Phase	OFF
	11.00	OFF, 30~90%	Under Current Protection (%)	OFF
	12.9F	0FF, 0.03, 0.05/0.1~3A	Ground Fault Operation Current (Zero sequence CT)	OFF
	13.9n	OFF, 20~500% (FLCmin)	Ground Fault Operation Current (Residual circuit)	OFF
	14.95	0.05, 0.1~1.0s	Ground Fault Operation Time	-
	15.9d	On/OFF	Ground Fault Delay During Start	ON
	15.1C	OFF, 500~1000%	Instantaneous Protection (%)	OFF
	17.10	ALt/TriP	Instantaneous Warning/Operation	TriP

Note) 1. When the rated current S/W is 100A, the CT ratio is not displayed.

2. Some menus are not displayed if relevant functions are not available.

#### **Setting Menu (B Group)**


Group	Menu	Setting Value	Description	Default Value
В	1.E - r	On/OFF	Electric Reset	On
	2.R-c	OFF, 1~20 min	Automatic Reset	OFF
	3.r-E	Hour/Minute	Run Time	Time Check
	4.5rE	OFF, 1~8760Hour	Run Time Setup (Hour)	-
	5.5 - d	2009/01.01/00:00	YY/MM/DD/ HH:MM (View/Setup)	-
	5.ErE	Day/hour:minute	Total Run Time	Time Check
	R.E - d	0.5~10/5~100A	Analog output	A 420 Model
	A.Adr	1~247	Communication Address	
	b.bP5	96/192/384	Communication Speed	M485 Model
	c.5-P	On/OFF	SWAP	

Note) 1. When the power is supplied first or is resupplied after a power failure, must set up the date (5.S-d).

2. Automatic reset is only possible in case of an excess current trip.

### **Operation and Setting**

### **IMP Series**

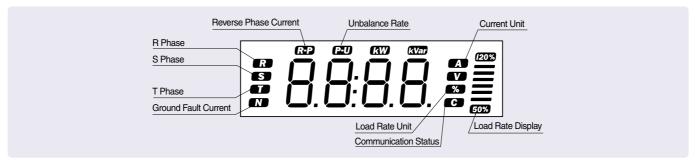

Note) kW, kVar, and V indicate the specification of the voltage models (under development).

#### **Operation Display**

Display	Description	Remark
0 - C	Over Current Trip	Operate within predefined time.
U-C	Under Current Trip	Operate within 3 seconds.
P-F	Open Phase Trip	Operate within 1.5 seconds when the unbalance rate is over 70%.
P-U	Unbalance Trip	Operate within 3 seconds.
Loc	Lock Trip	Operate within 0.5 seconds.
SEL	Stall Trip	Operate within 3 seconds.
r-P	Reverse Phase Trip	Operate within 0.1 second.
9-F	Ground Fault Trip	Operate within predefined time.
Sho	Instantaneous Trip	Operate within 0.05 seconds.
Or H	Elapsed Time (No Trip)	The operation time is reset when the Reset key is pressed.
C.Err	Communication Fault between Body and Di	splay (Press the ENTER/RESET key to return to the normal mode)

#### IMP Specifications for Low Voltage 3-Phase Induction Motors (Reference)

Full Load Current	IMP Settings			External CT	Motor Output (Less than kW)		
for the Motor	Current Selection S/W	Wire Tunnel	CT ratio	External C1	220V	380V	440V
0.7A or less		4 times	0.25	-	0.1	0.18	0.2
0.7~1.6A	0.5~10A	Twice	0.5	-	0.25	0.55	0.6
1.6~8A		Once	1	-	1.5	3	3.7
7~100A	5~100A	Once	1	-	25	45	55
90~120A	0.5~10A	Once	30	SCT-150	30	55	55
120A~160A		Once	40	SCT-200	45	75	90
160~240A		Once	60	SCT-300	55	110	132
240~320A		Once	80	SCT-400	90	160	160
320~400A		Once	100	500 : 5	110	200	200
400~480A		Once	120	600 : 5	132	250	250
480~640A		Once	160	800 : 5	160	320	320

Note) 1. This table is written based on the full load current.

#### Analog (DC 4~20mA) Output / Communication


- 1) The biggest current out of measured 3-phase currents is converted into DC 4mA~20mA and the current measured remotely by digital meter can be displayed.
- 2) When there is no current, 4mA is sent. If the current goes beyond the predefined value, 20mA is sent.
  - Output Current =  $\frac{16\text{mA}}{\text{Setting}} \times \text{Load Current} + 4\text{mA (Settings are changed in A.t-d of b-gr)}$
- 3) When the system is the 0.5A~10A setting mode, measurement starts from 0.3A. When the system is the 5A~100A setting mode, measurement starts from 3A. Thus, when the current is under 0.3A (3A), 0A is measured and output is 4mA. (To measure the load current correctly, an appropriate CT should be used).


Note) The allowable burden is less than 500Q.

Considering the receiver resistance (usually  $250\Omega$ ) and track resistance), the shielding cable should be used.

#### Communication Spec. :

Refer to G-41 page and LSIS Homepage (www.lsis.biz)






<sup>2.</sup> The CT is selected as a reference for the EMPR's current setting range.

### **Dimensions**

### **GMP Series**

GMP22-2P (1c) Sol

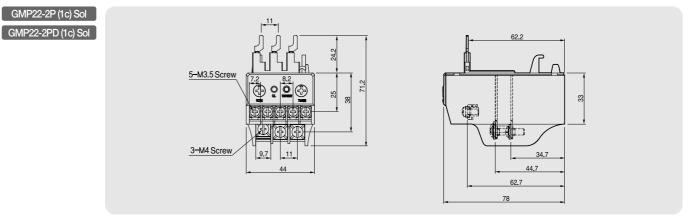


0.15kg

GMP22-2P (1a1b) Sol

GMP22-3P Sol

GMP22-2PA (1a1b) Sol

GMP22-3PR Sol

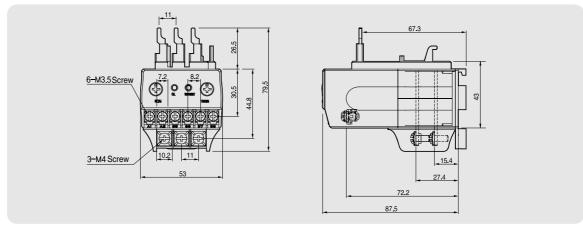


0.18kg

GMP40-2P Sol

GMP40-2PD Sol


GMP40-2PA Sol

GMP40-3P Sol GMP40-3PR Sol

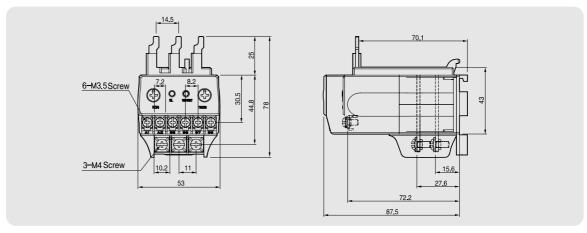

0.20kg/0.22kg

GMP80-2S

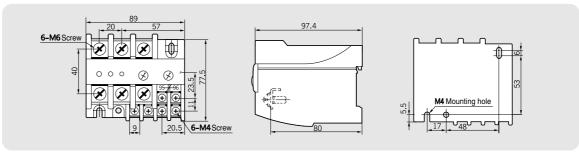


0.42kg/0.46kg

### **Dimensions**

### **GMP Series**


GMP22-2S GMP22-3S GMP22-3SR GMP40-2S GMP40-3S

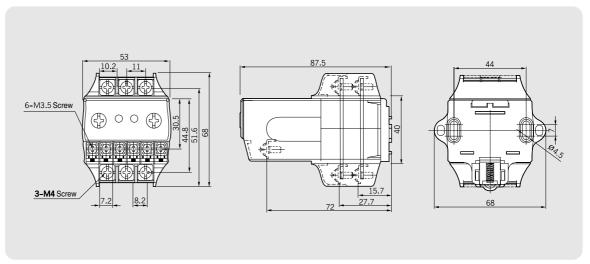

0.19kg/0.21kg


GMP22-2T GMP22-3T GMP22-3TR GMP40-2T

GMP40-3TR

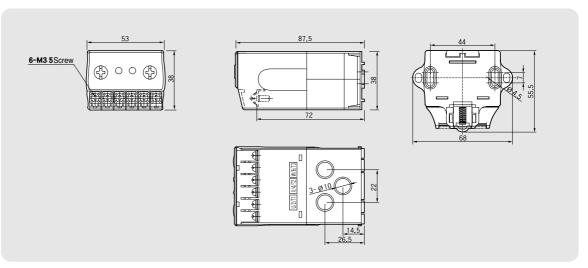

0.14kg/0.16kg

GMP60T GMP60TE GMP60TA

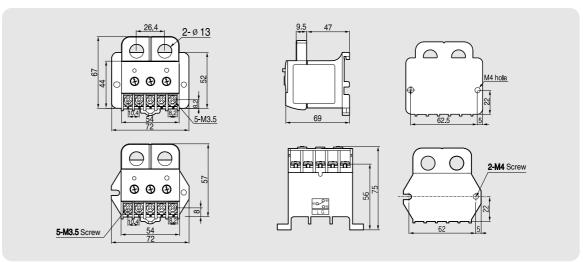


0.14kg

#### **Dimensions**

#### **DMP Series**


GMP60-TD

GMP60-TDa

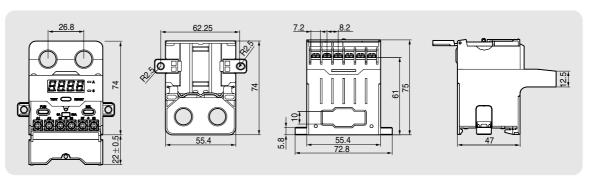



0.25kg

GMP60-3TZ, TZR GMP60-3TN, TNR GMP60-3T, TR

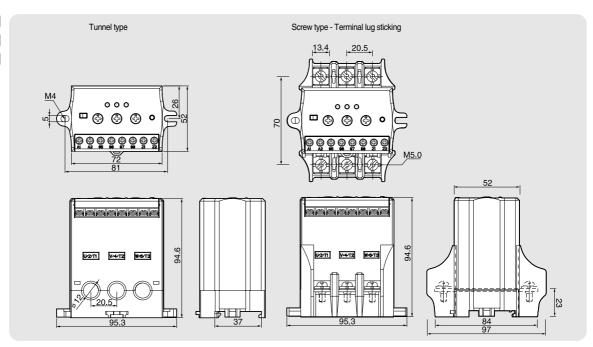



#### **Terminal arrangement**


















GMP60-TD GMP60-TDa




GMP60-3TZ, TZR GMP60-3TN, TNR GMP60-3T/3TR

Note) 1. Only for the GMP60-TZR modle. 2. Aux. Contacts are operate when power applied.

### **Dimensions**

#### **DMP Series**



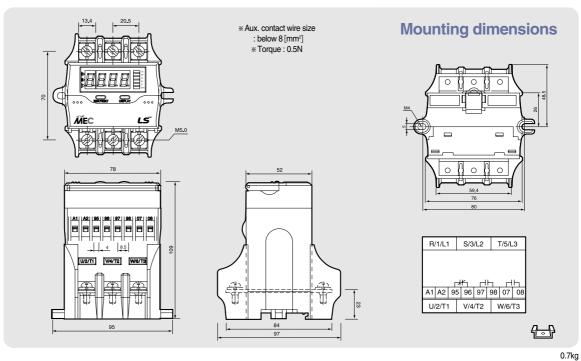


DMP\_-S


DMP\_-SZ

DMP\_-Sa

DMP\_-SZa

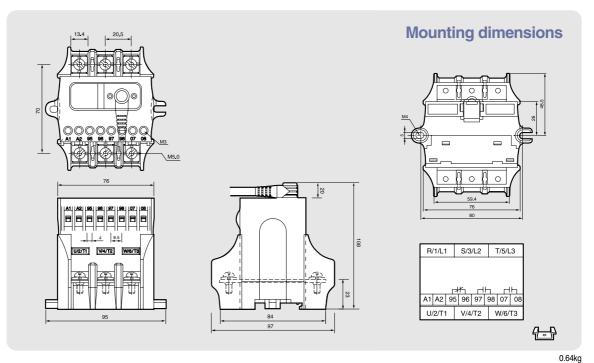

#### **Panel mounting**

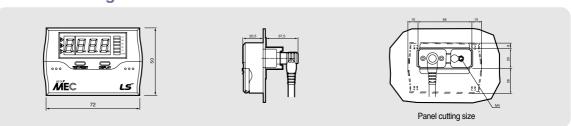

Note) 1. In extension type, the digital EMPR is calibrated with combining the display unit and mainbody so, please cautious not to combine the display unit and mainbody with different part No.


2. The 07-08 contacts are the ZCT input terminal (Digital EMPR with ground fault function)

0.56kg


### **Dimensions**

#### **DMP Series**




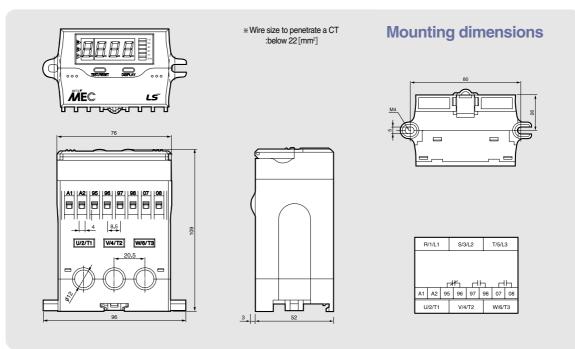



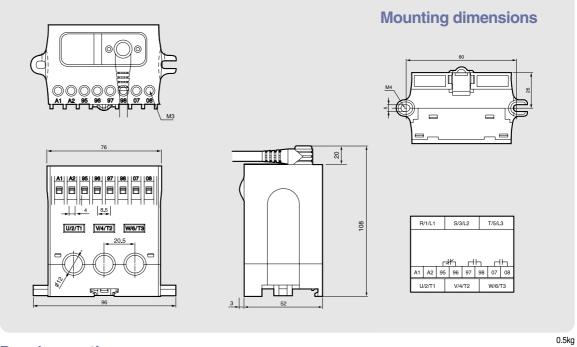

#### **Panel mounting**

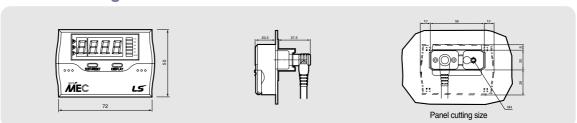


Note) 1. In extension type, the digital EMPR is calibrated with combining the display unit and mainbody so, please cautious not to combine the display unit and mainbody with different part No.

2. The 07-08 contacts are the ZCT input terminal (Digital EMPR with ground fault function)


### **Dimensions**

### **IMP Series**


One-Body Type

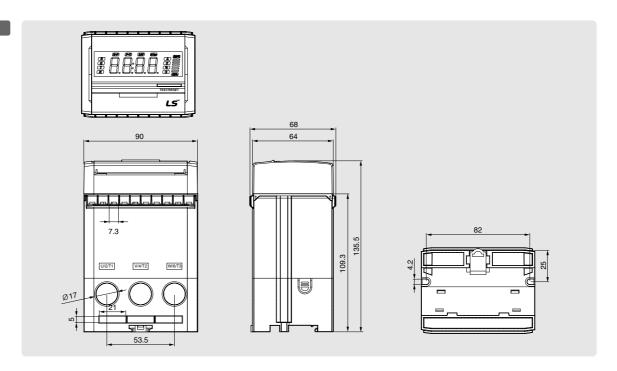

Separate BOdy Type

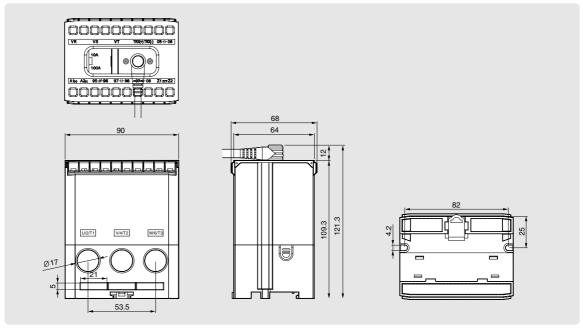

#### **Panel mounting**

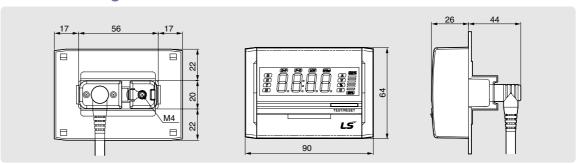


Note) The cable should be purchased separately (1m/1.5m/2m/3m).

### Wiring method


### **GMP Series**

GMP22-2P (1c)


GMP60T (1c)

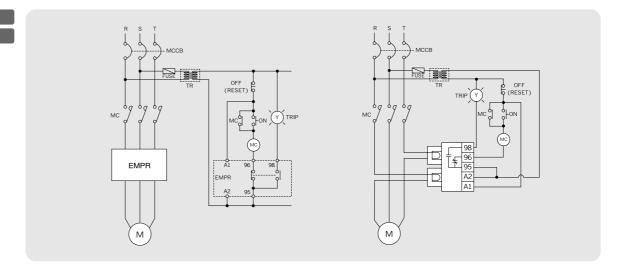

GMP□-□ (1a1b)

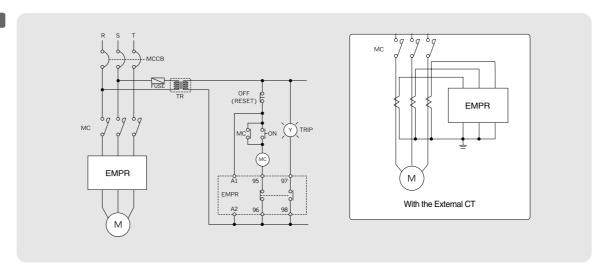


GMP60-3TZ, TZR GMP60-3TN, TNR GMP60-3T, 3TR

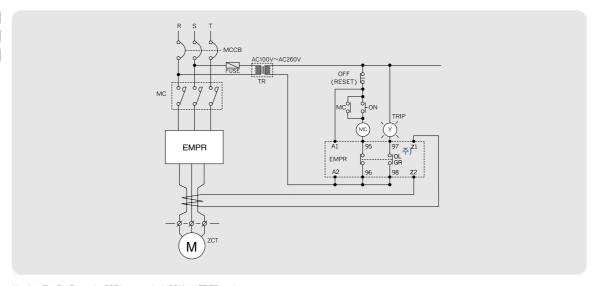

Note) 1. The Z1, Z2 are the ZCT input terminal (GPM60-3TZ/TZ type) 2. Aux. contacts are operate when power applied.


## Wiring method DMP Series

DMP-S/Sa DMP-T/Ta

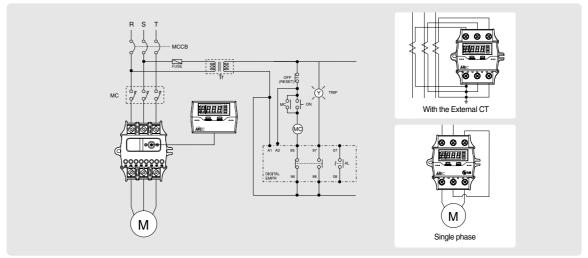


Note) When the single-phase motor is used, reverse phases protection should be set off.


DMP-SZ/SZa DMP-TZ/TZa

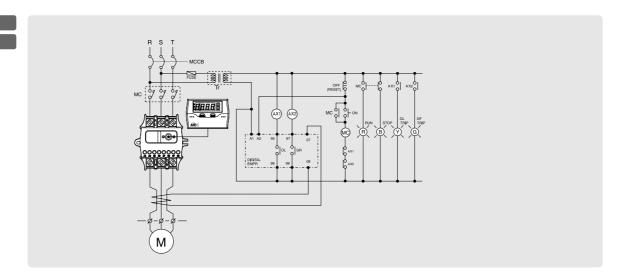

DMP-SZ/SZa DMP-TZ/TZa

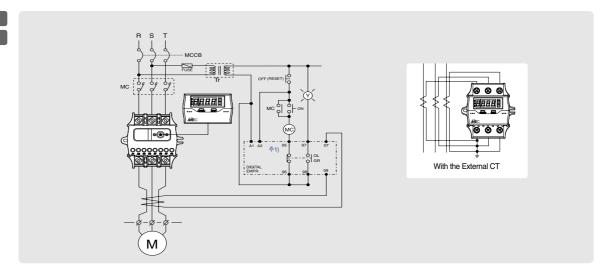


### Wiring method **IMP Series**

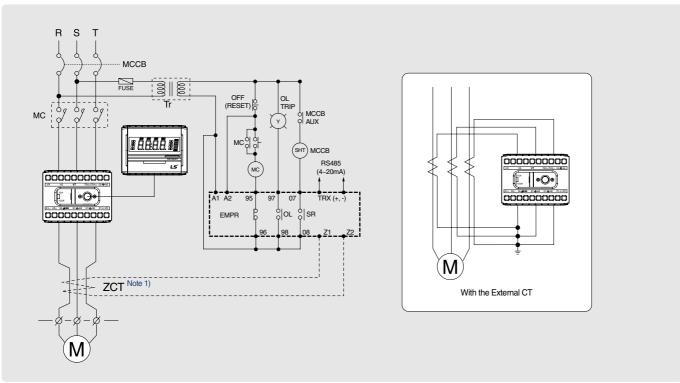

Note) 1. When the zero-phase-sequence current transformer is used to detect ground faults, connect the ZCT.

2. When the single-phase motor is used, all phases are connected except the S phase, and open-phase, unbalance and ground fault should be set OFF.

#### **Terminal layout**

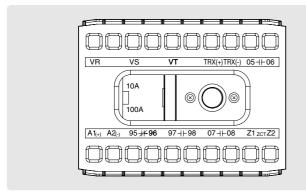

#### **Communication specification**

- Operation mode: Differential

- Distance: Max. 1.2km

- General RS-485 shielded twist 2-pair cable

- Baud rate: 9600/19200/38400bps - Transmission method: half-Duplex - Max. In/Output voltage: -7V~+12V

#### **Terminal Configuration**

Engrave	Description	Remark		
A1(+), A2(-)	Input terminal for operation power	AC/DC85~245V		
95-96	When the power is ON (NC contact output)	In case of an instantaneous trip, if 17.lo is ALT, it is NC, and if 17.lo is Trip, it is NO.		
97-98	When the power is ON (NC contact output)	In case of an instantaneous trip, regardless of 17 .10 setup, it is NC.		
07-08	Converted to the NC mode only when an instantaneous trip occurs.			
Z1, Z2	Output terminal for the zero-phase sequence current transformer	Specific ZCT (for the EMPR)		
TRX(+)	RS485 terminal (TRX+) Or 4~20mA (+) output	M405 A400 Time		
TRX(-)	RS485 terminal (TRX-) Or 4~20mA (-) output	M485, A420 Type		
10A/100A	Max. rated current change S/W	10A : 0.5~10A, 100A : 5~100A		
VR/VS/VT	3-phase voltage input terminal	N/A		
05-06	Output terminal for voltage protection	IVA		

Note) 1. The 3-phase voltage input terminal and 05-06 output terminal should be connected only for voltage protection models, which will be released in the future.


2. For RS485 connection, the terminal resistance should be 120Q.

<sup>3.</sup> For 4~20mA current, the maximum burden should be less than  $500\ensuremath{\mathrm{Q}}$ 

### **Accessories**

CT, ZCT, Cable and Terminal

### • CT (Current Transformer)

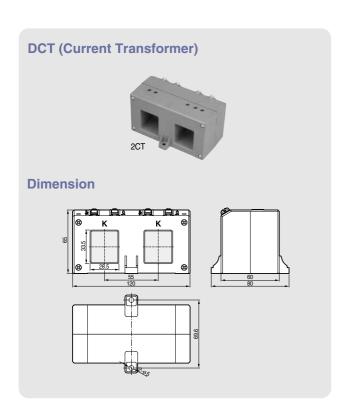

#### **Ratings**

Т	уре	2CT		
	DCT-100	100 : 5A		
	DCT-150	150 : 5A		
CT ratio	DCT-200	200 : 5A		
	DCT-300	300 : 5A		
	DCT-400	400 : 5A		
Class		1.0		
Burden		5VA		
Insulation volta	ge	600VAC		
Insulated impul	se voltage	2kV		
Insulation resis	tance	10 № (DC 500V Megger)		
Mounting		Panel		

Note) Please use DCT for LS Electronic Motor Protection Relay only.

#### With GMP60T




#### **Ratings**

Т	уре	зст		
	SCT-100	100 : 5A		
	SCT-150	150 : 5A		
CT ratio	SCT-200	200 : 5A		
	SCT-300	300 : 5A		
	SCT-400	400 : 5A		
Class		1.0		
Burden		5VA		
Insulation voltage	ge	600VAC		
Insulated impul	se voltage	2kV		
Insulation resist	tance	10 MΩ (DC 500V Megger)		
Mounting		Panel		

Note) Please use SCT for LS Electronic Motor Protection Relay only.

#### With GMP60-3T/DMP/IMP



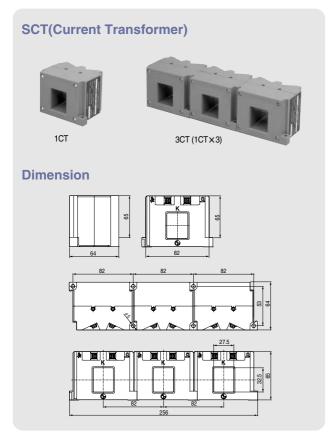

#### **Accessories**


### CT, ZCT, Cable and Terminal


### • ZCT (Zero Sequence CT)

#### **Ratings**

Туре	Diameter (A)	Ratio	Weight (kg)	Model
ZCT, D30	30		0.5	LZT-030
ZCT, D50	50	100mA/40~55mV	0.7	LZT-050
ZCT, D65	65	200mA/100mV	0.9	LZT-065
ZCT, D80	80		1.5	LZT-080

#### **Dimension**

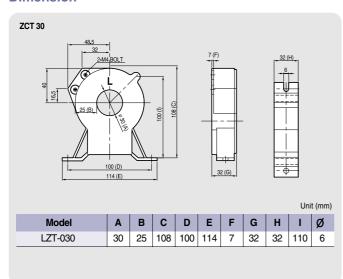

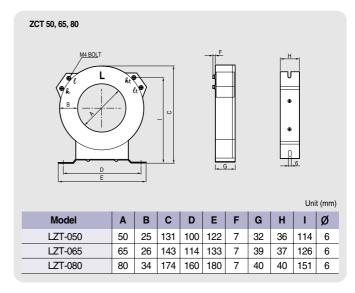


### Other Options

#### Cable



#### **Terminal Block**

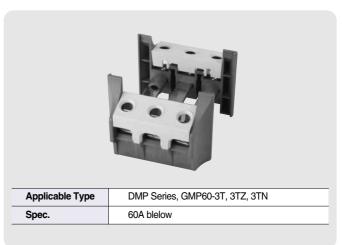

### Direct mounting EMPR new/old comparative table

Туре		GMP22-2P (1c) GMP22-2PD (1c)	GMP22-2P GMP22-3P GMP22-3PR		GMP40-2P GMP40-2PD GMP40-2PA	GMP40-3P GMP40-3PR
Number of		2	2	3	2	3
	Over current	~	<b>~</b>	<b>✓</b>	<b>✓</b>	<b>✓</b>
Protective	Phase failure	~	<b>V</b>	<b>✓</b>	<b>V</b>	<b>✓</b>
function	Locked rotor	~	<b>✓</b>	<b>V</b>	<b>✓</b>	
	Phase unbalance			V ()		<b>✓</b>
	Reverse phase	40DDT (4.)	00007	✓ (PR)	✓ (PR)	
Aux. contact (at E		1SPDT (1c) 0.3~1.5, 1~5, 4.4~22A	2SPST 0.3~1.5, 1~		2SPST (1a1b) 4~20, 8~40A	
Metasol (New)	EMPR	5-M3,5Bolt 2 2 3 2 3 2 3 2 3 2 3 2 3 2 3 3 3 3 3	6-M3.5Bolt		6-M3.5 Bolt 2-2 0 8-2 3 9 9 9 9 9 9 9 9 9 9 9 9 9 9 9 9 9 9	
	Demension	62.2 83 34.7 44.7 62.7 78	67,3 67,3 9 15,4 27,4 72,2 87,5		70.1 70.1 15.6 27.6 87.5	
	Type of contactors	MC-9b, 12b, 18b, 22b	MC-9b, 12	b, 18b, 22b	MC-32	a, 40a
Meta-MEC	EMPR Demension	5-M3.5Bolt	6-M3.5Bolt		6-M3.5Bolt	
(Old)		62.2 62.2 83 93 94.7 78 57.2 GMC-9, 12, 18, 22	65 65 72 27.8 87.5		65.1 65.1 72 87.5 GMC-32, 40	
Type of contactors Wiring/Mounting Compatibity Note)		NO	GMC-9, 12, 18, 22 NO		GMC-32, 40 NO	
Retrofit Type (Tunnel)		GMP60T (1c)	GMP22-2T	GMP22-3T	GMP40-2T	GMP40-3T
		GMP22-2T	GMP60TA (1c)	GMP22-3TR	GMP60T (1c) GMP60TA (1c)	GMP40-3TR

Note) If you want to use Metasol EMPR with GMC Contactors, only tunnel type EMPR is available.